



Current Countermeasures

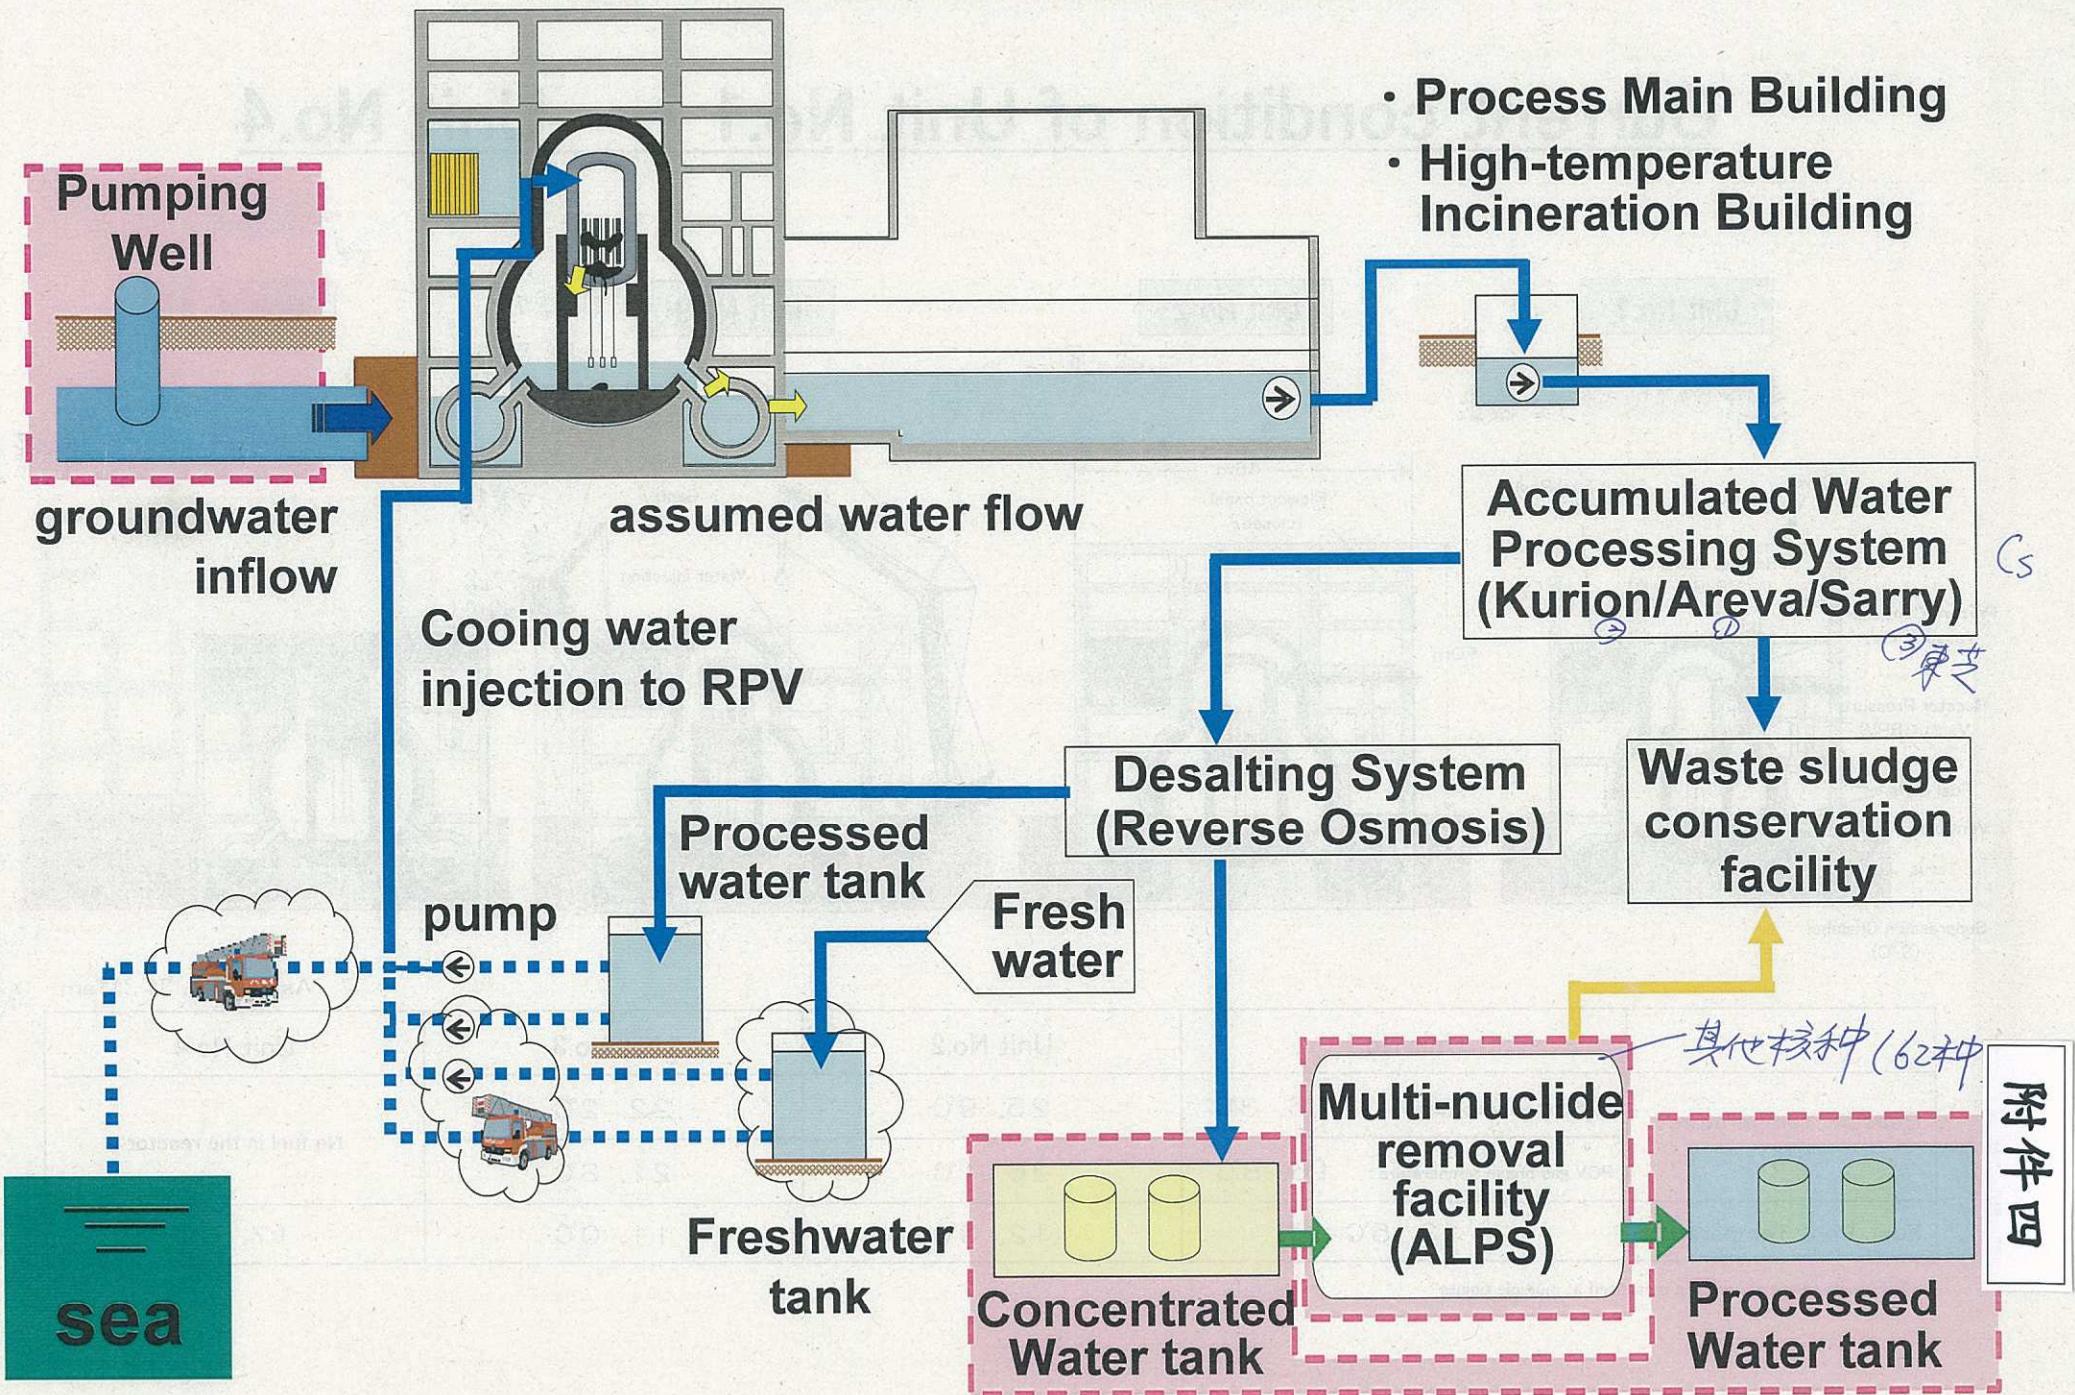

Current condition of Unit No.1 ~ Unit No.4

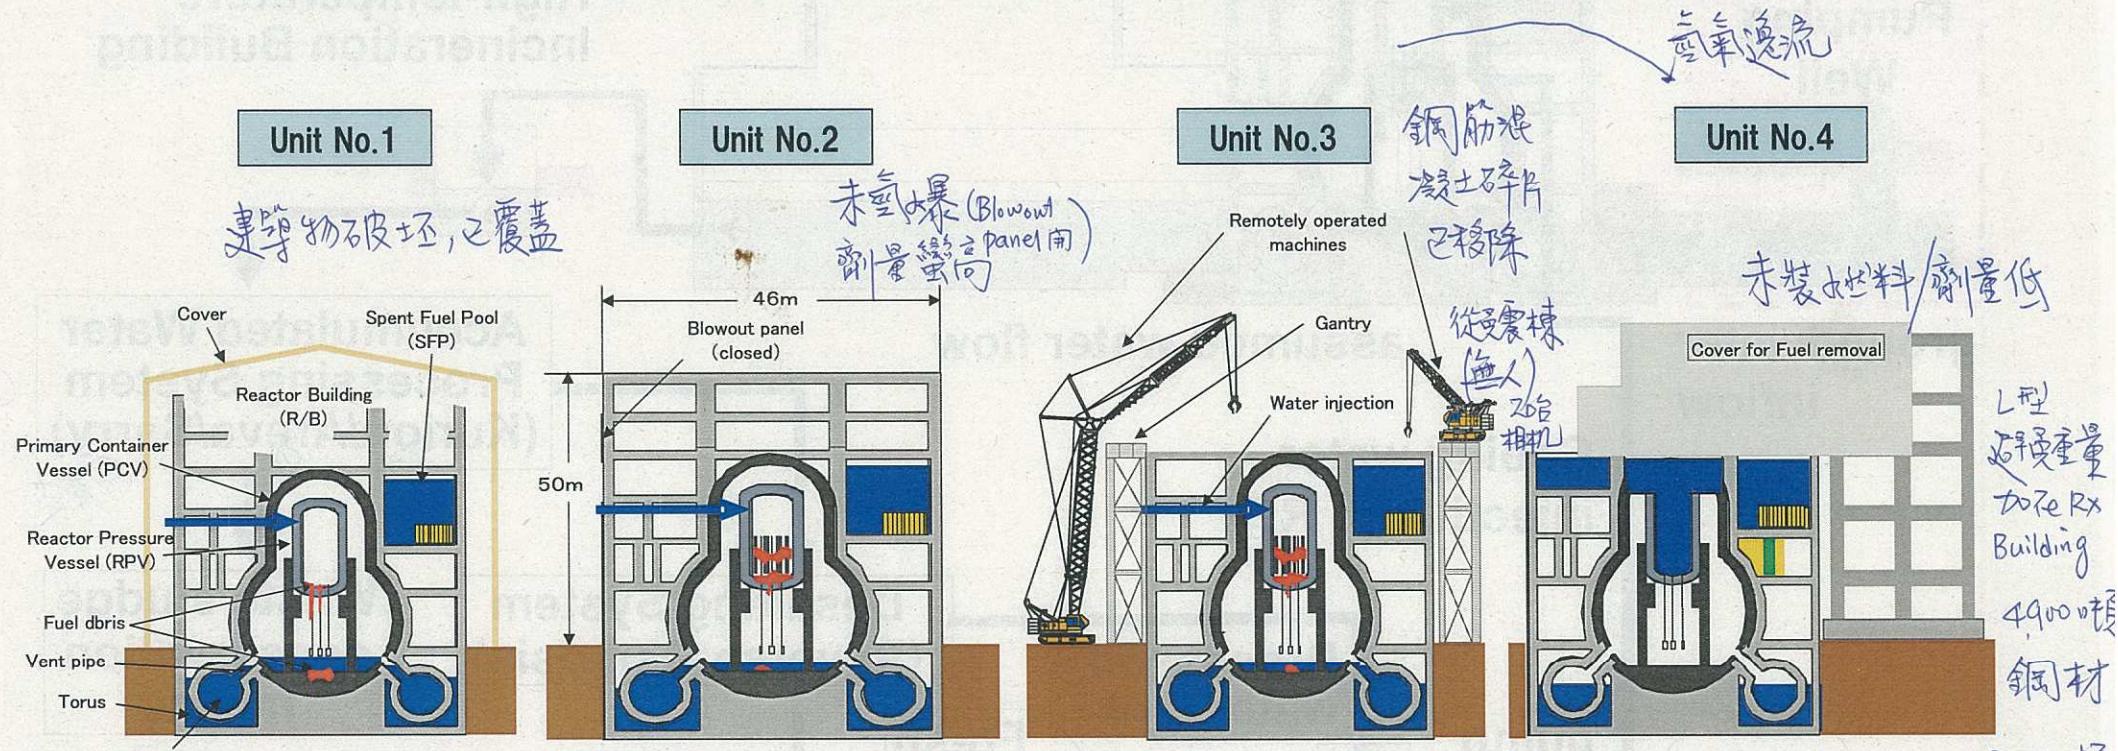

As of Jan. 31, 11am

13000噸
的基礎

	Unit No.1	Unit No.2	Unit No.3	Unit No.4
Reactor Temperature (※)	RPV bottom temperature : 16. 3°C	25. 9°C	22. 2°C	No fuel in the reactor
	PCV gas phase temperature : 16. 8°C	26. 1°C	21. 3°C	
Fuel Pool Temperature	13. 5°C	12. 3°C	11. 0°C	17. 6°C

※ Sample temperature date measured at multiple points